



Unit: mm (approx. inch)

### Measurement Span Code F

- Vertical Impulse Piping Type

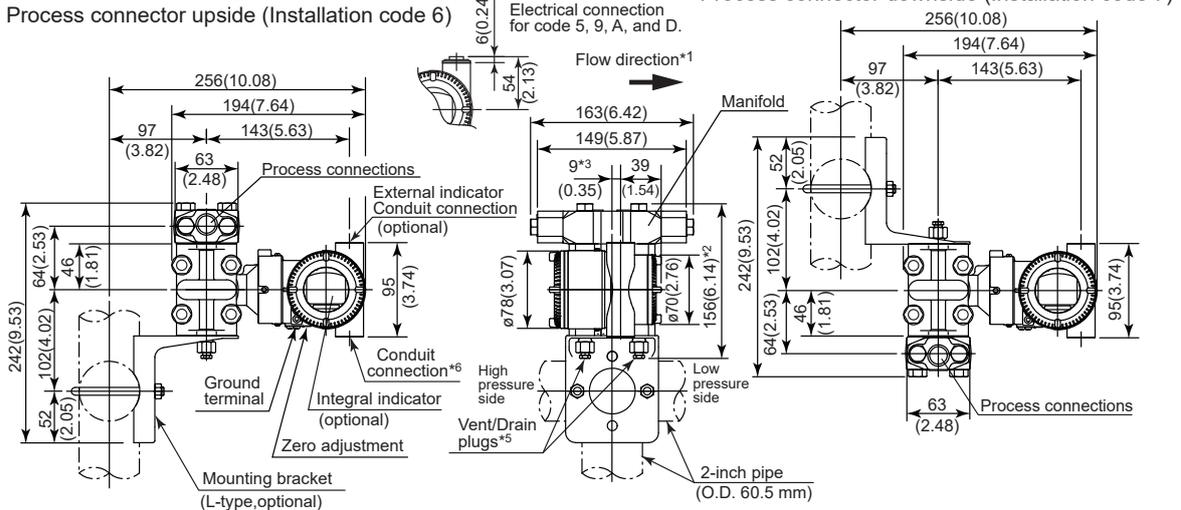

- Horizontal Impulse Piping Type (Installation code 9)

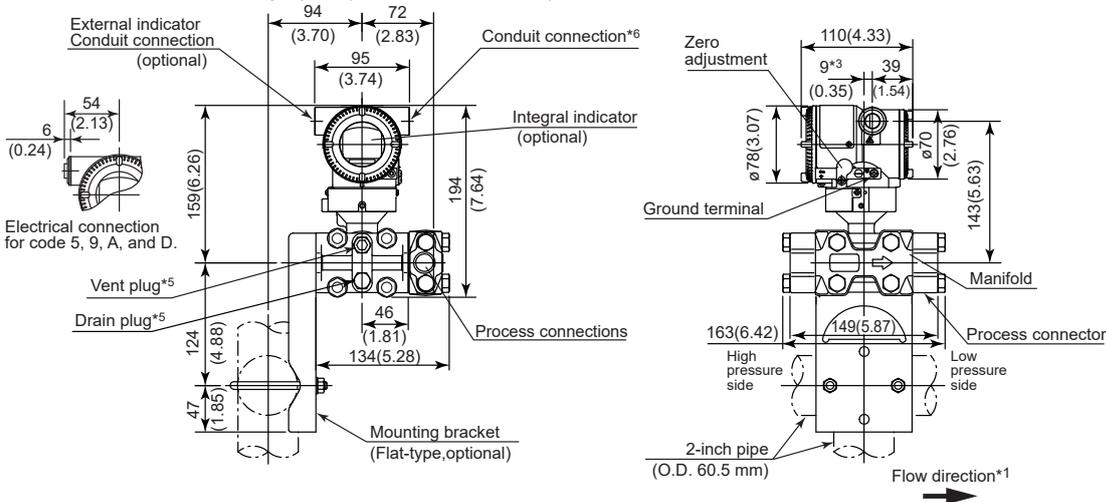

\*1: When Installation code 2, 3, or 8 is selected, the flow direction on above figure is reversed.  
(i.e. the arrow faces to the left [ ← ])

\*2: When Option code K1, K2, K5, K6, K41, K42, K45, or K46 is selected, add 15 mm (0.59 inch) to the value in the figure.


\*3: 15 mm (0.59 inch) when Installation code 2, 3 or 8 is selected.

\*4: When electrical connection code 7 or C is selected, a blind plug is protruded up to 8 mm (0.31 inch) from the conduit connection.

\*5: When option code UN is specified, Vent/Drain holes and plugs are not applicable.

\*6: When option code PP is selected, a blind plug is attached to the conduit connection on both sides.

- Terminal Configuration

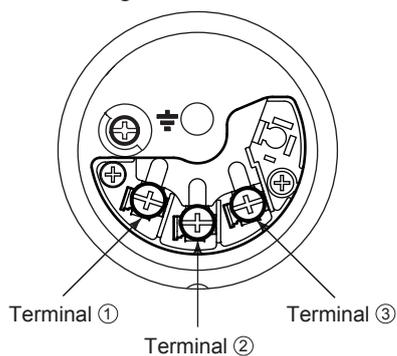

- Terminal Wiring

SUPPLY	+	①	] Power supply and output terminals
	-	②	
CHECK	+	③	] External indicator (ammeter) terminals*1*2
or	-	②	
ALARM	+	③	] Status contact output terminals*2
	-	②	
			⏏ Ground terminal

\*1: When using an external indicator or check meter, the internal resistance must be 10  $\Omega$  or less. A check meter or indicator cannot be connected when /AL option is specified.

\*2: Not available for FOUNDATION Fieldbus and PROFIBUS PA communication types.